



Inception corona discharge voltages in SF₆-N₂ gas mixtures at high gas pressure

Ahcene LEMZADMI¹, Faïçal BELOUCIF¹, Assia GUERROUI¹, and André DENAT²

¹LGEG, fac: ST, Univ 08 Mai 1945 Guelma, Algeria

²LEMD/CNRS; Grenoble.25, Avenue des martyrs, BP.166, 38042 Grenoble France.
lemzadmi@yahoo.fr

Abstract: The use of sulphur hexafluoride (SF₆) has led to increased concentration of this gas in the atmosphere. The purpose of this work is to investigate the behaviour of SF₆-N₂ mixtures that can be considered as a potential substitute of pure SF₆. The onset corona discharge voltages have been determined from the measurements of the current-voltage characteristics under high pressures and with highly inhomogeneous fields. The results show that the onset voltages increase with the increase of the gas pressure and are relatively higher for positive polarity. It can also be seen that for low concentrations of SF₆ in the mixture the increase of the onset voltages is substantial, followed by a slow increase for elevated concentration of SF₆ in the mixture, which, can be an advantage for the substitution of SF₆.

Keywords: corona discharge, sulphur hexafluoride, insulating gas.

1. Introduction

Among electronegative gases SF₆ (sulphur-hexafluoride) has found a wide range of applications due to its superior insulating properties and chemical stability. As the size of the high voltage equipments increases the cost of insulating gas becomes appreciably high. The quantity of SF₆ released in atmosphere is therefore rising. Due to its ability to absorb and reemit IR make it a potent greenhouse gas [1-2]. With its high lifetime (more than 2000 years), it accumulates in the atmosphere and contribute to the global warming of the atmosphere, therefore SF₆ will be severely controlled in the next years. The by-products issued from decomposition of SF₆ exposed to electric discharges may be dangerous to the equipments (corrosion) and to the personnel (poisoning) [3].

These factors have stimulated the research of a replacement gas with little environmental impact. The most promising alternative is the use of gas mixtures of SF₆ with inexpensive common gases such as nitrogen (N₂). SF₆-N₂ gas mixtures have good dielectric strength, are non-toxic, non-flammable and they have a high arc quenching capacity with a good self healing ability. The purpose of this paper is to provide and discuss the measurements of the onset corona discharge voltages in SF₆-N₂ gas mixtures at higher pressure ranging from 3 to 15 bars and with different percentage of SF₆. The onset voltages were determined from the measurements of the current-voltage curves in both negative and positive polarities. A tip-plane configuration was used with the tip radius of few micro-meters and the gap between the electrodes is lower than 10 mm. Most of the data available deals with the breakdown voltages rather than the threshold voltage of corona discharge.

2. Experimental set-up

Experiments were made in a stainless-steel cell of 50 cc equipped with two quartz windows as shown in figure 1. Electrodes in a tip-to-plane configuration were mounted inside the cell. The tip electrode of few micrometers is made of tungsten and, is prepared by electrolyse technique, steel tips are also used. The gap between the electrodes varies from 5 to nearly 10 mm. The tip electrode is connected to the high D.C. voltage up to 60 kV. The stainless steel plane electrode with a radius of 12 mm is connected to an galvanometer which measures

currents down to some microamperes. Before the cell was filled with the gas, pumping was undertaken pushing the vacuum down to nearly 3.10^{-2} Pa. The gas was introduced in the cell without prior purification. The SF_6 used in these experiments is delivered with a purity of 99.97%. The measurements were made for pressures ranging from 3 bars to 15 bars. A partial pressure method is used to mix the gases in the cell. SF_6 was first introduced followed by nitrogen. It is supposed that SF_6 and N_2 do mix quite well. The current was measured when the voltage varies upwards and downwards and after each set of measurements a resting time is observed to allow the mixture to settle down. The tip electrode is regularly changed in order to limit the radius variation due to the deposit of fluorine and sulphur. Analysis of used tips by electronic microscopy has been carried out.

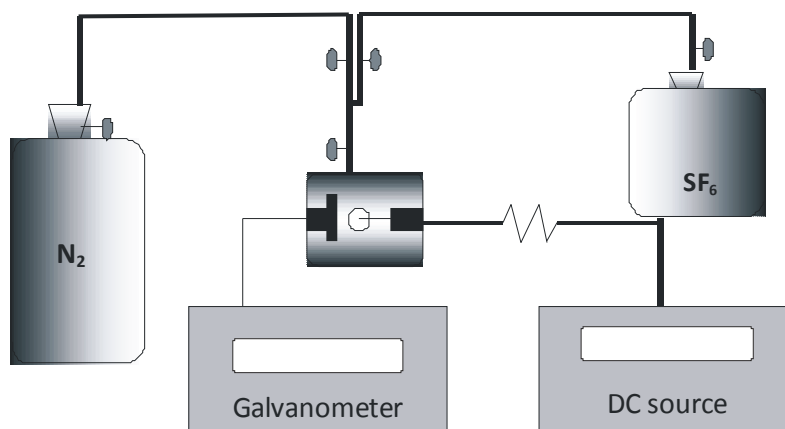


Figure 1. Experimental set-up.

3. Results and discussion

The current-voltage characteristics $I = f(V_s)$ of corona discharge in SF_6 - N_2 gas mixture show that the current follows an exponential law. The measured values of corona inception voltages (V_s) as a function of the ratio of SF_6 in the mixture are shown in Figure 2 and 3 for negative and positive polarities respectively. The curves have the same tendency for both polarities and the V_s values increase with the increase of the amounts of SF_6 . This behaviour may be attributed to the decrease of the net ionisation coefficient α [4-5].

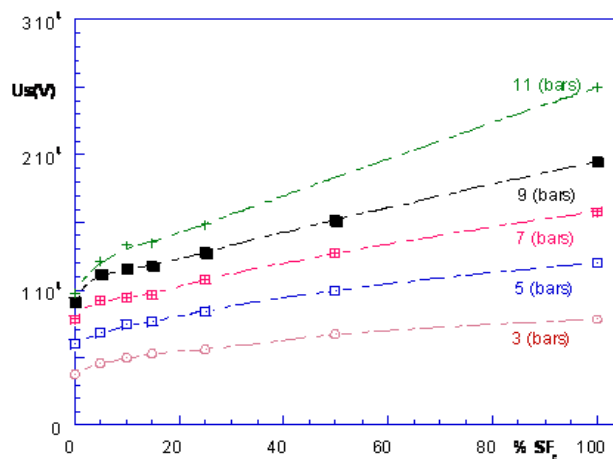


Figure 2. Curves of the onset voltages as a function of the ratio of SF_6 in the SF_6 - N_2 mixture and gas pressure for negative polarity.

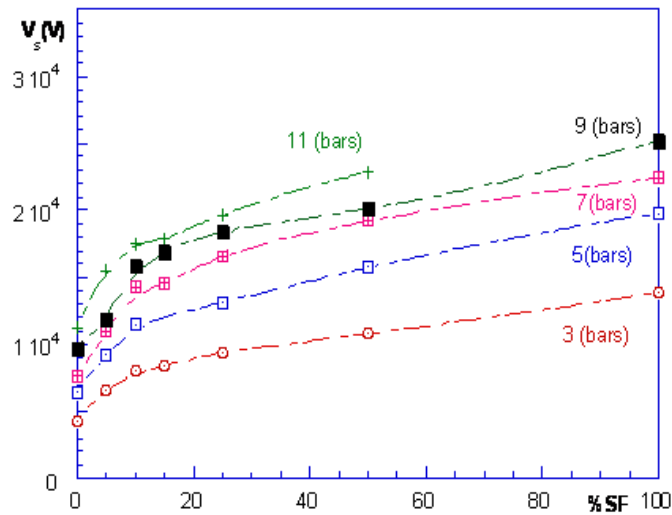


Figure 3. Curves of the onset voltages as a function of the ratio of SF₆ in the SF₆-N₂ mixture and gas pressure for positive polarity.

At higher amounts of SF₆, the onset voltages tend towards saturation. This tendency was observed in previous work [4]. The saturation may be attributed to the change of the surface of the tip electrodes. To check this assumption the surface was analysed using electronic microscopy. The analysis showed that there's some deposit on the tip after a set of electric discharge, this deposit is composed of fluorine and sulphur, but since tests are carried out with decreasing pressure such effect cannot explain saturation for higher pressures, where the tip is quite free of deposit. The saturation may be the result of the concentration of space charges, which are more active at the vicinity of the tip electrode at higher pressure [6]. It is interesting to see that a small admixture of SF₆ in the mixture provokes a sharp increase of the onset voltages of the corona discharge, which constitutes an argument for the replacement of SF₆ by SF₆-N₂ gas mixtures having very small percentage of SF₆.

Figure 4 illustrates the corona inception voltage as a function of the gas pressure for different concentrations of SF₆ in SF₆-N₂ gas mixtures for negative and positive polarities. It can be seen that the positive onset voltages are relatively higher than those of the negative polarity as found by [7-8]. This can be attributed to the mechanism of generation of initiatory electrons. Under positive polarity the main source for production of electrons is the detachment from negative ions and the difficulty for negative ions to reach the tip electrode. For negative polarity the field effect emission increases the probability of free electrons extracted from the cathode surface, which is at the highest electric field in the gap. The effect of polarity is predominant for higher amounts of SF₆ [9.]

Using the curves of figure 2 and 3, we were able to measure the working pressure for different SF₆-N₂ gas mixtures, which, can be very useful for electrical engineers. In Figure 5, are drawn the working pressure values as a function of the percentage of SF₆ for a constant onset voltage (13.8 kV) for both polarities.

In the present conditions, and for a constant onset voltage equals to 13.8 kV, a mixture of 100 % of SF₆ has a pressure equals to 3 bars for a positive polarity, whereas, for 10 % of SF₆ the pressure rises to 6.5, in order to withstand the same onset voltage. In negative polarity a mixture of 100 % of SF₆ has a pressure equals to 7.3 bars; whereas, for 10 % of SF₆ the pressure reaches 13 bars, in order to withstand the same inception voltage (13.8 kV). This result is of great interest for practical application in high voltage insulation, where GIS are used.

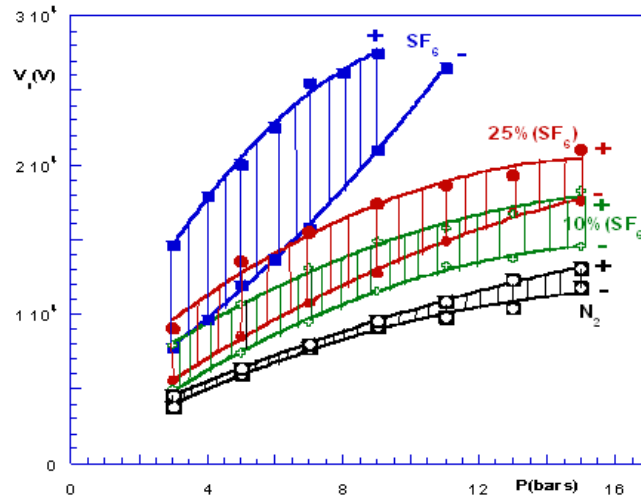


Figure 4. Corona inception voltage as a function of the gas pressure for different concentrations of SF₆ in SF₆-N₂ gas mixtures and for negative and positive polarities

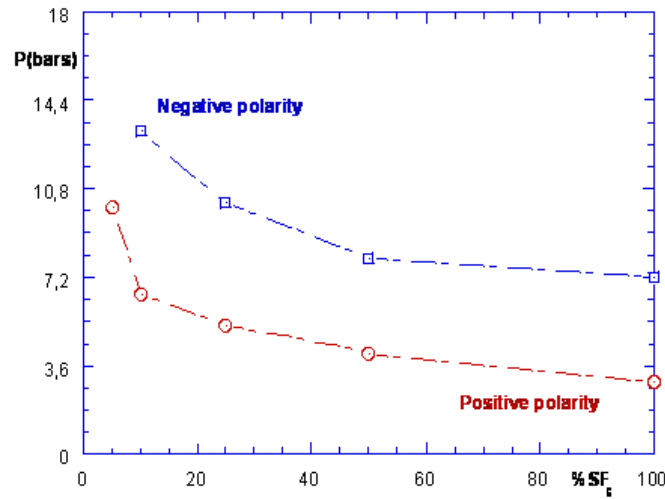


Figure 5, curves of the pressure as a function of the percentage of SF₆ for the same onset voltage (13.8 kV).

The theoretical determination of the corona inception voltage V_s is based on the expression first derived by Nitta and Shibuya [10]. The model is based on the streamer criterion as follows:

$$V_{inception} = \left(\frac{E}{P} \right)_{lim} * u * P * d * \left(1 + \frac{C}{\sqrt{P * r_p}} \right) \quad (1)$$

Where d = gap spacing, r_p = radius of the tip electrode, P = Gas pressure.

Where u is the field utilisation factor:
$$u = \frac{E_{average}}{E_{maximum}} \quad (2)$$

The ratio of the average to the maximum electric stress, defined as the utilization factor u , is a useful criterion when comparing different electrode systems. u has been derived from the ratio of d/r_p . Figure 6 shows the dependence on gas pressure of negative inception voltage on a 10%N₂-50% SF₆ gas mixture when the electric field utilization factor is varied by changing the needle tip radius curvature from 3μm to 15μm and finally 40μm. As can be seen clearly, when the electric field nonuniform coefficient is varied by changing r_p , the onset voltage characteristics are found to vary [11]. When r_p is reduced corona discharge voltage drops, this is in concordance with the values found by [12]

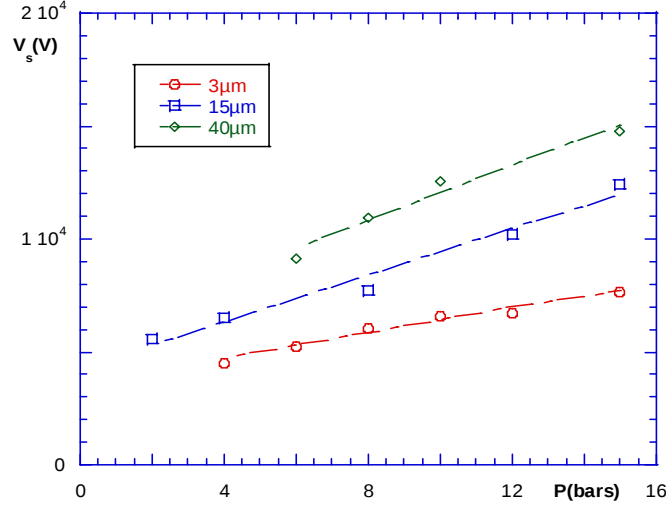


Figure 6. The dependence on gas pressure of negative inception voltage on a 10% N₂-50% SF₆ gas mixture with different values of tip radius.

The constant C in equation (1) can be determined by the following equation:

$$C = \sqrt{\frac{4K}{\beta_m * (E/P)_{lim}}} \quad (3)$$

With K is the streamer criterion constant and β_m comes from the approximation of the net ionisation coefficient α^* of the mixture: $\alpha^* = (\alpha - \eta)$, α and η are respectively the ionisation and attachment coefficients.

$$\alpha^* = \beta_m * \left[\left(\frac{E}{P} \right) - \left(\frac{E}{P} \right)_{lim} \right] \quad (4)$$

Determination of $(E/P)_{lim}$: It is the value of reduced field for which the equilibrium between ionisation and attachment is realised.

$$\alpha^* \left[\left(\frac{E}{P} \right)_{lim} \right] = 0$$

For $(E/P) > (E/P)_{\lim}$, ionisation becomes predominant and the streamer phenomena occurs in the gap whereas, for $(E/P) < (E/P)_{\lim}$, there is no possibility to start a streamer. Malik and Qureshi [9] calculated $(E/P)_{\lim}$ for SF_6 - N_2 mixtures making the assumption that:


$$\left(\frac{\alpha}{P}\right)_{\lim}^* = z * \left(\frac{\alpha}{P}\right)_{SF_6}^* + (1-z) * \left(\frac{\alpha}{P}\right)_{N_2}^* \quad (5)$$

with z = ratio of SF_6 .

However, since nitrogen and SF_6 do not interact with electrons of the same range of energy, this assumption is not rigorously exact. Kline and al. [13] have shown that there's good agreement between experimental results and those calculated using the empirical expression:

$$\left(\frac{E}{N}\right)_{\lim} = \left(\frac{E}{N}\right)_{SF_6} * (\%SF_6)^{0.18}. \quad (6)$$

In Figure 6, a comparison of the experimental results of the present work, the results found by Malik and Quershi [9] and those determined using the Kline and et.al. model[13] for pure SF_6 . The models results are in good concordance with the values measured in this present work. Whereas, for a mixture of 10 % of SF_6 in the SF_6 - N_2 gas mixture (Figure 7), the models overestimate the onset voltage for negative polarity. Kline's values are higher than the values determined by Malik and Quershi. The models overestimate V_s for low SF_6 ratio (10% SF_6) and are concordant for pure SF_6 . The discrepancy between the models decreases with the increase of the percentage of SF_6 in the gas mixture. The experimental values of corona inception voltages (V_s) increase linearly with pressure up to 9 bars, then show deviations from the theoretical behaviour and tend to saturate. Such deviations are often attributed to surface effects, which are more sensitive at high pressure [9].

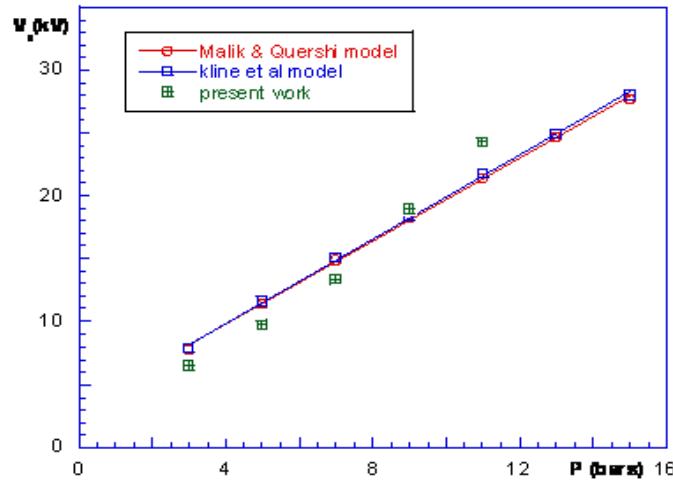

In Figure 6, a comparison of the experimental results of the present work, the results found by Malik and Quershi[9] and those determined using the Kline and et.al model [13] for pure SF_6 .

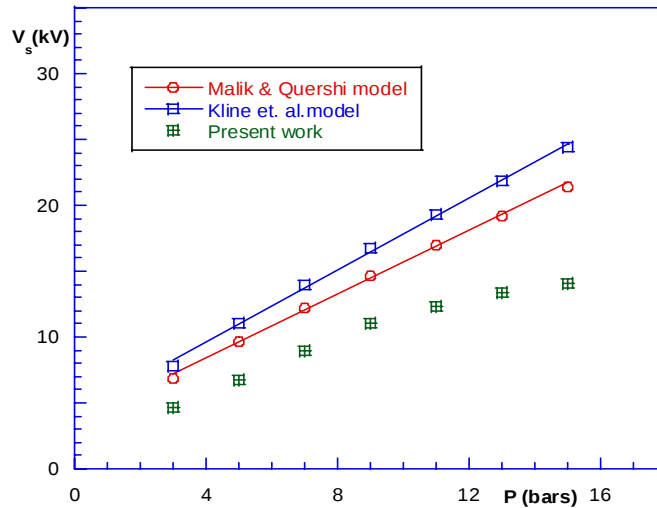


Figure 6, a comparison of the experimental results V_s (kV) of the present work, the results found by Malik and Quershi [9] and those determined using the Kline and et.al model [13] for 10% of SF₆.

4. Conclusion

The corona onset voltages V_s increase with the increase of the amounts of SF₆ but at higher pressures the measured values tend to saturate. The positive onset voltages are relatively higher, especially for high percentage of SF₆. The polarity effect is predominant for higher amounts of SF₆. For the same onset voltage a mixture with 10 % of SF₆ must works approximately at twice the pressure of pure SF₆. This is true for both polarities. The models considered in this work predict quite well the corona onset voltage for pure SF₆, whereas for SF₆-N₂ Mixtures with 10% of SF₆ they overestimate the values of the inception voltage.

References

- [1] L. Niemeyer & F. Y. Chu "SF₆ and the atmosphere", *IEEE Trans Elect Insul.* 1992, Vol. 27.
- [2] L. G. Christophorou & R. J. Van Brunt "SF₆/N₂ Mixtures Basic and HV Insulation Properties", *IEEE Trans on diel. and Elect. Insul*, 1995 vol 2 N° 5.
- [3] F. Y. Chu. "SF₆ Decomposition In Gas-Insulated Equipment" *IEEE .Trans. on Elect. Insul.* , 1986, Vol.EI-21 No. .5.
- [4] A. H. Cookson and B. O. Pederson, "Analysis of the HV Breakdown Results for mixtures of SF₆ with CO₂, N₂ and Air", *3th Int. Symp. HV. Engineering, Milan*, 1979, pp. 31-10.
- [5] C. M. Cooke and R. Velazquez, "The insulation of ultra HV in coaxial Systems Using Compressed SF₆ gas", *IEEE Trans. Power App. Syst*, 1977, Vol.96, pp. 1491-1497.
- [6] V. K. Makdawala, D. R. James and L. G. Christophorou, "Effect of ionisation processes on the corona stabilisation breakdown in SF₆ and SF₆-mixtures", *4th Int. Symp. On High Voltage Engineering. Athens, Greece*, 1983, pp.1-4.
- [7] Tomoyuki Hirata, Hideki Ueno, and Hiroshi Nakayama "Characteristics of N₂/SF₆ Mixture Gas in Creeping Discharge Developing in Narrow Gap with Backside Electrode" *Electrical Engineering in Japan*, , 2007, Vol. 158, No. 2.
- [8] F. A. M. Ritzk & M. B. Eteiba "Impulse breakdown voltage-time curves of SF₆ and SF₆-N₂ in coaxial cylinder gaps" *IEEE, Transactions on Power Apparatus and Systems*, 1982, vol. PAS-101. No. 12, pp.4460-4471.
- [9] 18- Malik and Qureshi, "Calculation of Discharge Inception Voltages in SF₆/N₂ Mixtures", *IEEE Trans. on EI*, vol. EI-14, No. 2, 1979, pp. 70-76.

- [10] Nitta and Shibuya, "Electrical Breakdown of Long Gaps in Sulphur-Hexafluoride", *IEEE Trans; on PAS*, vol. PAS-90, No. 3, 1971, pp. 1065-1071.
- [11] H. Mcl. Ryan, "Electric field of rod-plane spark gap", *Proc. IEE*, Vol. 117, 1970, 283-284.
- [12] Shinya Ohtsuka et.al "Insulation Properties of a CO₂/N₂ 50% SF₆ Gas Mixture in a Nonuniform Field" *Elect. Eng. in Japan*, Vol. 121-B, No. 7, July 2001, pp. 830–836
- [13] Kline and al., "Dielectric Properties for SF₆ and SF₆ mixtures predicted from basic data", *J. Appl. Phys.*



Ahcene Lemzadmi is an Associate Professor in the Department of Electrical Engineering and Automation at Guelma University, Algeria. Received a doctorate degree in Electrical Engineering from the University of Annaba in association with the university Joseph Fourier of Grenoble (2006), France, and a master degree from the University of Strathclyde, Glasgow Scotland.UK (1986). Director of the Electrical Engineering Laboratory (LGEG) at the university 8 mai 1945 Guelma, Algeria. The main research activity is the High Voltage and Electrical Discharge in Dielectrics.



Beloucif Faïçal received a Master degree in the Department of Electrical Engineering and Automation in 2008 at Guelma University, Algeria. A lecturer and PhD student in the Department of Electrical Engineering and Automation at Guelma University, Algeria. The main research activity is the Load Flow, High Voltage and Electrical Discharge in Dielectrics.



Assia Guerroui received a Master degree in the Department of Electrical Engineering and Automation in 2008 at Guelma University, Algeria. A PhD student in the Department of Electrical Engineering and Automation at Guelma University, Algeria. The main research activity is the High Voltage and Electrical Discharge in Dielectrics.



André Denat started his career in the chemical industry, and then joined the academic institution as an engineer. He obtained his Doctorate in physics (1982) and is now full-time researcher (Directeur de Recherches) at the Centre National de la Recherche Scientifique (CNRS). He was the head of the Laboratory for Electrostatics and Dielectric Materials (LEMD) in Grenoble from 1997 up to 2004. His fields of interest are the study of high field conduction phenomena and their influence on the initiation of pre-breakdown events: injection of charges at metal insulating liquid interfaces, electron avalanches in insulating liquids and gases, spectroscopic analysis of discharges, phase transition induced by discharges, etc.