



## Performance Improvement of the Ceramic Outdoor Insulators Located at Highly Polluted Environment Using Room Temperature Vulcanized Silicone Rubber Coating

Fari Pratomosiwi and Suwarno

School of Electrical Engineering and Informatics  
Institut Teknologi Bandung  
Jl. Ganesha 10 Bandung 40132

**Abstract:** Ceramic insulators are widely used in transmission as well as in distribution lines. As outdoor insulators, the ceramic insulators are subjected to environmental stresses. In particular case, the insulators may severe high pollution exposure. Under the polluted condition, high leakage current will flow on the insulator surface and dry band arching may take place. The phenomena may initiate the insulator flash over leading to the failure of the lines. Several efforts may be taken to improve the insulator performance under polluted condition. Recently, adding of hidrophobic agent on the insulators was introduced to improve the performance of ceramic insulators under polluted condition. This paper reports the experimental results on the application of room temperature vulcanized (RTV) silicone rubber coating on the medium voltage ceramic insulators under various environmental conditions. The samples were put in a test chamber with controlled humidity and pollution condition. The characteristics of RTV Silicon Rubber coated insulator were analyzed, such as its leakage current (LC), hydrophobicity (indicated by measuring contact angle) and Surface Smoothness (indicated by Scanned Electron Microscopy (SEM)) of the RTV Silicon Rubber insulator surface. The LC's waveform parameters such as magnitude and harmonic content (as indicated by the total harmonics distortion (THD)) were analyzed. It was found that the coating was significantly suppressed the magnitude of leakage current and drastically eliminated the harmonic content. The gradient of cross product value between LC magnitude and THD was proved to be a better indicator to show insulator condition rather than LC or THD alone. The coating also significantly increased the flash over voltage of the insulator. Surface analysis indicated that increasing of the water repellence and enhancement of surface resistance of the insulators played important role in the increase of the insulator performances. These experimental results will be the basis of application of RTV Silicon Rubber coated insulator under polluted conditions, especially in Indonesia.

**Keywords:** silicone coating, ceramic insulators, highly polluted, flashover voltage

### 1. Introduction

In a power system, insulator plays an important role to isolate among live parts and between live parts and ground and as mechanical protector. The insulator are widely used at substations, transmission and distribution network as well [1].

Ceramic insulators are widely used in power system since long time ago. At present time the insulators are still widely being used. Ceramic insulator has good mechanical and electrical properties and less expensive. Nevertheless, as outdoor insulator it has some weaknesses especially under certain environmental factors such as humidity, rainy season and pollution which may reduce their surface resistance. The reduction of surface resistance may enhance the leakage current to flow on the surface [2]. Leakage current (LC) with large magnitude flow on the surface for long period may cause degradation of the insulator surface [3]. One of many

ways for improving its performance is coating with Room Temperature Vulcanized (RTV) Silicone Rubber.

This paper reports the experimental results on the leakage current, hydrophobicity and surface smoothness of RTV Silicone Rubber coated insulator under various artificial conditions.

## 2. Experiments

### A. RTV Silicone Rubber Coated Insulator

Post pin ceramic insulators with 20 kV operating voltage were used as samples. The samples were coated with silicone rubber by using high pressure nozzle with thickness of about 0.3 mm.



Figure 1. Pictures of non coated (a) and RTV coated (b) samples

The RTV silicone rubber coating materials were made by Dow Corning. The pictures of the samples are shown in Figure 1. A test chamber made from aluminium panel with size of 90 cm x 90 cm x 120 cm was used to simulate pollution exposed to the samples. The front opening of the test chamber was made from acrylic to facilitate the observation of arcing on the sample surface.

For salt layer test, 40 g kaolin was used in every 1 litre water and NaCl was added to the solution to get the desirable conductivity in accordance with IEC Standard No. 507 1991 (salt layer test and salt fog test). For salt fog test, 40 g kaolin was used in every 1 litre of water and NaCl was used as salt fog. The detail of experimental conditions investigated in this experiment are tabulated in Table 1.

Table 1. Experimental Conditions

Test #	Insulator and Environmental Condition	Applied voltage(kV)
1	Clean insulator; clean fog	10-60
2	Insulator polluted with kaolin-salt pollution at 1.3 mS; clean fog	10-60
3	Insulator polluted with kaolin-salt pollution at 2 mS; clean fog	10-60
4	Insulator polluted with kaolin-salt pollution at 3.6 mS; clean fog	10-60
5	Insulator polluted with kaolin pollution; salt fog at 2 mS	10-60
6	Insulator polluted with kaolin pollution; salt fog at 3 mS	10-60
7	Insulator polluted with kaolin pollution; salt fog at 3.6 mS	10-60

### B. Leakage Current Measurement

An AC high voltage of 50 Hz was applied to the insulators. The applied voltage was adjusted to get various conditions such as normal condition, small or high activity of dry band arcing.

The leakage current flowed on the insulator surface was measured by measuring the voltage across a series resistance using a Digital Oscilloscope TDS series with digitizer of 8 bit, bandwidth of 100 MHz, and the maximum sampling rate of 1 Gs/s.

LC waveforms including low and high frequency components were obtained. The digital data was transferred to a personal computer through a GPIB for further analysis. The leakage current waveform is usually a distorted-sinusoidal [4]. The harmonics content determines the degree of distortion from the sinusoidal. In this experiment, the LC waveforms were measured using a computer-aided measurement system and the harmonic content was analysed.

Fourier transformation is used to analyse the harmonic content of the leakage current. In this case we used FFT (*Fast Fourier Transform*) which can be obtained in MATLAB to analyse the leakage current harmonic. For the quantification of the harmonic content of the leakage current we used the THD (total harmonic distortion). The THD is defined as the total ratio of the harmonic components and the fundamental which can be expressed as:

$$\text{THD} = \frac{\sqrt{\sum_{n=2}^{\infty} I_n^2}}{I_1} \quad (1)$$

where  $I_1 = 1^{\text{st}}$  harmonic (fundamental)  
 $I_n = n^{\text{th}}$  harmonic for  $n = 2, 3, 4, \dots$

### C. Hydrophobicity and Surface Smoothness

Hydrophobicity of RTV silicone rubber coated insulator surface is indicated by its contact angle. The contact angle was taken using Sony digital camera with macro lens.

Insulator surface smoothness also been investigated. It is analysed if there is any dependency between the smoothness of insulator surface and hydrophobicity of insulator surface

## 3. Experimental Results

### A. Analysis of Leakage Current Magnitude and THD

#### 1) Leakage current for samples at clean fog condition (test 1-4):

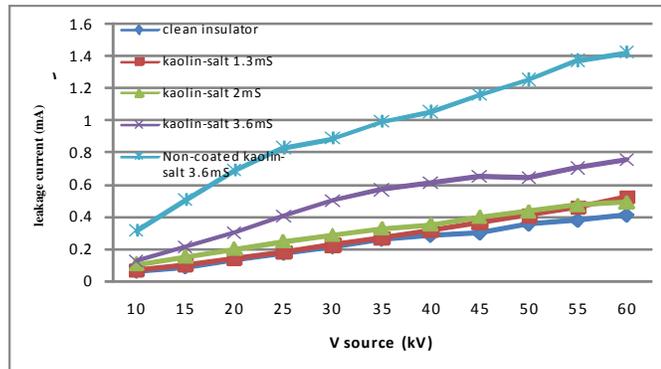


Figure 2. LC magnitude as function of applied voltage for insulator polluted with various kaolin-salt pollution under clean fog

Figure 2 shows the dependencies of leakage current for clean sample and kaolin-salt polluted samples on the applied voltage for both RTV Silicone Rubber coated and non-coated insulator. It is clearly seen that LC magnitude increase almost linearly with the applied voltage. Figure 2 also shows that the LC magnitude greatly affected by the different pollution levels applied on the samples. On applied voltage 10 kV, it can be seen that the LC magnitude almost the same for clean sample and kaolin-salt samples. Along with the increasing of applied voltage, the LC magnitude of kaolin sample is higher than the clean sample. The amounts of salt applied also affected the LC. The greater amount of kaolin-salt pollution caused higher LC magnitude. At 60 kV, the highest LC magnitude flowed on insulator polluted with kaolin-salt pollution at 3.6 mS and the lowest LC magnitude flowed on clean sample. The greater amounts of kaolin-salt pollution increase the surface conductivity. Conductive surface caused the LC flowed on insulator surface increased. It can also be concluded from Figure 2 that LC magnitude of insulator with greater amount of pollution has greater gradient as a function of applied voltage. We can also see from Figure 2 that LC magnitude of non-coated ceramic insulator much higher than LC of RTV Silicone Rubber in the same experimental condition (kaolin-salt 3.6 mS). It means that the RTV Silicone Rubber coated suppressed the magnitude of leakage current flowed. It also means that RTV Silicone Rubber coated can maintain surface resistance since the LC magnitude for various polluted conditions almost the same. This phenomenon does not happen for the non-coated ceramic insulators which cannot maintain its surface resistance under polluted conditions.

Figure 3 shows the dependencies of total harmonic distortion (THD) of LC waveform on the applied voltage and the amounts of kaolin-salt pollution. It is clearly seen that THD increase with the applied voltage. However, Figure 6 also indicates that THD value for kaolin-salt polluted insulator under clean fog was decreased together with the increasing amounts of pollution applied. This is due to the increase of surface conductivity and reduction of electric field. This phenomenon also applied for the non-coated ceramic insulators.

There was not any flashover or spark observed from clean and kaolin-salt polluted insulator with RTV silicone rubber coated. Whereas it was reported [4] that spark observed at 40-60 kV for ceramic outdoor insulator under similar experiment.

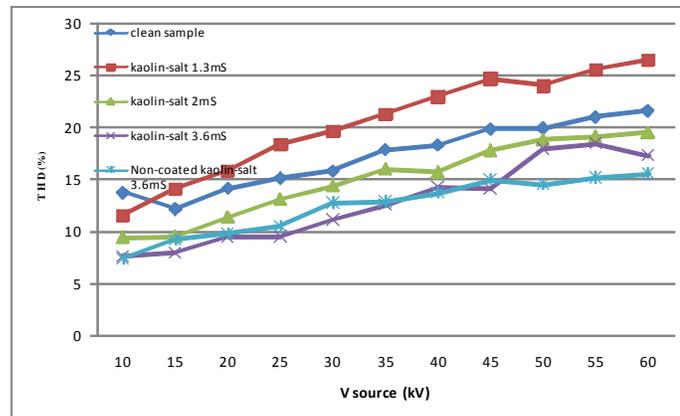


Figure 3. THD as function of applied voltage for insulator polluted with various kaolin-salt pollution under clean fog

These results indicate that RTV silicone rubber coating improves the performance of ceramic outdoor insulator. RTV silicone rubber coating suppressed the magnitude of leakage current, the harmonic content of leakage current and increased the flashover voltage. The low LC corresponds with high surface resistance which indicates high quality of insulator.

2) *Leakage current for kaolin polluted under salt fog condition (test 5-7):*

This experiment is suitable to represent insulator that placed on seashore with high salt fog conductivity.

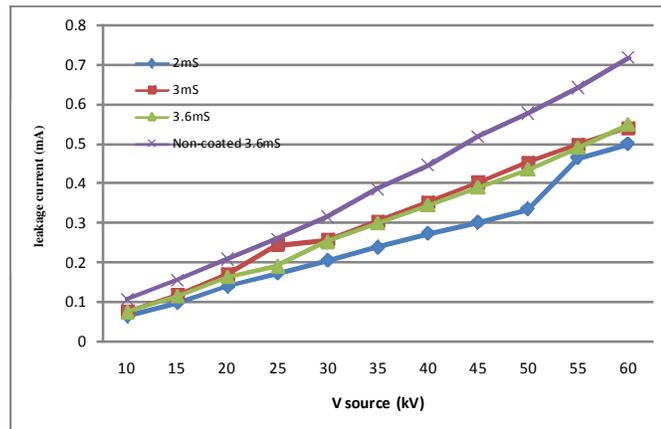


Figure 4. LC magnitude as function of applied voltage for insulator polluted with kaolin-pollution under salt fog with various conductivity

Figure 4 shows the dependencies of LC magnitude on applied voltage for kaolin polluted under salt fog with conductivity of 2, 3, and 3.6 mS. The LC magnitude increase linearly together with the applied voltage. Figure 4 also shows the magnitude of leakage current is almost equal under various salt fog conductivity of 2, 3, and 3.6 mS. It can be seen that salt fog conductivity did not affect the magnitude of LC since the magnitude of LC under various salt fog conductivity was almost the same. Compared to the LC magnitude under clean fog, the LC magnitude under salt fog was almost equal. Figure 4 also shows the LC magnitude for non-coated ceramic insulators higher for salt fog conductivity of 3.6 mS. It means that salt fog conductivity affect the magnitude of LC since the LC magnitude increased along with increased in salt fog conductivity [4].

Figure 5 indicates that the THD of kaolin polluted under salt fog were almost equal for conductivity of 2, 3, and 3.6 mS. The THD increases slightly with applied voltage. Meanwhile, the THD for non-coated ceramic insulators reduced along with the increase of salt fog conductivity. This is due to the increase of surface conductivity. However, this phenomenon did not occur with RTV silicon rubber coating because salt fog conductivity did not increase the surface conductivity. Therefore the THD value was not decrease along with salt fog conductivity.

The results can be explained as follows. Because of RTV silicone rubber coating, the increase of salt fog conductivity did not affect the surface conductivity. Usually for the non-coated ceramic insulator, kaolin polluted surface exhibit a hydrophilic property.

Under salt fog with high conductivity, the kaolin is trapping the salt water and drastically increases the surface conductivity. This process enhances the current to flow on the insulator surface. However, the most important property of RTV silicone rubbers for insulator coating is their retention of water repellence [5]. The silicone rubber give water repellence to the polluted surface because low molecular weight silicone fluid that diffuses from the bulk of the coating surrounds contaminants with a monolayer of fluid that imparts a non-wetting property, or hydrophobicity, to the contaminant layer. In addition, the monolayer of fluid which surrounds the contaminant also inhibits dissolution of the contaminant in water. As a result, the electrolytic layer that develops is weak and not conducive to the development of leakage current and flashover. So it be concluded that the salt fog conductivity do not affect the LC magnitude as well as its harmonic content of ceramic insulator coated with RTV silicone rubber.

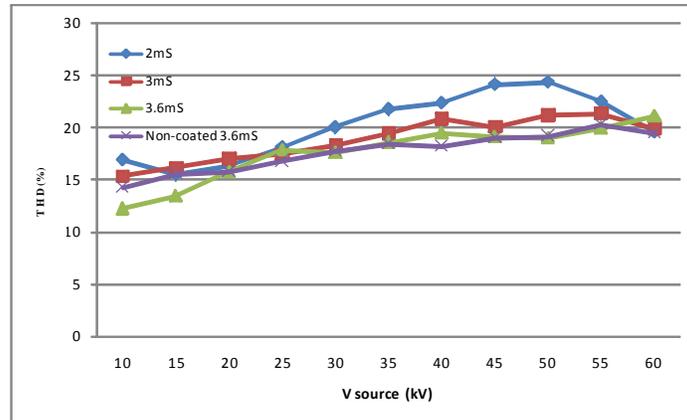


Figure 5. THD as function of applied voltage for insulator polluted with kaolin- pollution under salt fog with various conductivity

#### B. Gradient of Cross Product Between LC Magnitude and THD as an Indicator of Insulator Condition

Some papers reports that high THD value of leakage current waveforms correlated with the appearance of dry band arcing on sample surface prior to flashover. However, for RTV Silicone Rubber coated insulator this assumption does not apply. Experimental results, as shown in Figure 3 and Figure 5, shows that THD value of RTV coated insulator are pretty high compared to non coated, but this condition does not exactly point out that the severity of insulator surface condition especially RTV coated insulator. From experiment, we found out that there is no flashover observed for RTV coated even though at highly polluted condition it has higher THD value compared to the non-coated insulator. THD value for RTV Silicone rubber is higher or at least equal with THD for non-coated for the same applied voltage and under the same experimental condition.

However, experiment for insulator polluted with extreme pollution kaolin-salt 20ms/cm, under clean fog show that the non-coated insulator flashover at 50 kV, meanwhile at 60 kV the RTV coated insulator does not flashover and there are no arc observed.

From this experiment, it is concluded that we cannot apply the assumption that high THD value revealed the severity of insulator surface condition for every condition and every insulator. We might add, this assumption is correct for certain extreme polluted condition and certain type of insulator. High value of fundamental harmonic order might reduce the THD of insulator. For example, the THD for RTV coated at under kaolin-salt 1.3 mS are higher than the THD for non-coated at kaolin-salt 3.6 mS, but that does not mean that the RTV coated surface condition is more severe. It is mainly because the THD for RTV coated has lower value of fundamental harmonic order compared to the non-coated insulator. That condition causes high THD value. In reality, the non-coated insulator has more severe surface condition due to its high value of fundamental harmonic order and high polluted.

LC magnitude also cannot reveal the insulator surface condition. High LC corresponds with low surface resistance which indicates low quality of insulator. The high magnitude of LC in turn will heat the insulator surface and may promote the degradation of the insulator. High LC magnitude revealed the severity of insulator surface condition. But at certain condition, we may find the oscillation effect where the LC magnitude is change with time. The occurrence of dry band may cause oscillation of LC magnitude. That is why LC magnitude alone is not a reliable indicator of insulator condition.

Some paper [6] reports that the cross product between LC magnitude and THD value is a better indicator to show insulator condition. Our experiments also show the same results. The cross product between LC magnitude and THD value for insulator under various polluted condition show that the most severe condition has the highest cross product value. The gradient of cross product value is a better indicator of insulator surface condition. Table 2 shows the gradient of cross product between LC magnitude and THD value for insulator at clean fog condition.

Table 2. The Gradient Of Cross Product At Clean Fog Condition.

No	Condition	Gradient of Cross product
1	clean insulator	0.166056
2	kaolin-salt 1.3	0.260704
3	kaolin-salt 2	0.181710
4	kaolin-salt 3.6	0.265171
5	kaolin-salt 3.6 (non coated)	0.398623

Table 3 shows the gradient of cross product between LC magnitude and THD value for samples at salt fog condition.

Table 3. The Gradient Of Cross Product At Salt Fog Condition.

No	Condition	Gradient of Cross product
1	Salt fog 2	0.194991
2	Salt fog 3	0.205739
3	Salt fog 3.6	0.206231
4	Salt fog 3.6 (non-coated)	0.257702

Table 2 and Table 3 show the gradient of cross product between LC magnitude and THD value for insulator for various experimental conditions. The gradient of cross product between LC magnitude and THD value is a better indicator to show insulator condition. As we can see from Table above, the gradient of cross product for non-coated insulator generally higher than the RTV coated insulator. This indicator agrees with the experimental results. From the Table, the RTV coated has lower gradient of cross product value which clearly indicates that application of RTV coated improves the performance of ceramic insulator. The gradient of cross product also shows that kaolin salt layer affects the ceramic insulator surface more than salt fog because it has higher value.

Furthermore, we might use the gradient of cross product between LC magnitude and THD value to set a new indicator of insulator condition by setting standard value of the gradient to show the severity of insulator condition. This is possible if we have lots of data for all kind of insulators. We can create new standard indicator of insulator condition by using the gradient of cross product between LC magnitude and THD value. In Table 4, we give an example of standard indicator of insulator condition by using the gradient of cross product between LC magnitude and THD value. Therefore, we should set an interval of gradient that appropriate of each insulator condition and characteristics.


Table 4. Example Table Of The Gradient Of Cross Product At Salt Fog Condition

Level of Severity	Interval of Gradient Cross Product	Characteristics
Good	X	X
Warning	X	X
Severe	X	X

X : Related contents

C. Analysis of Leakage Current Waveform

Leakage current for samples at clean fog condition: Figure 6 compared typical leakage current waveforms for RTV Silicone Rubber coated insulator and non-coated ceramic insulator for kaolin-salt polluted under clean fog at applied voltage (a) 10 kV, (b) 40 kV and (c) 60 kV. The waveforms slightly distorted from their sinusoidal due to presence of harmonic components especially 5th component.

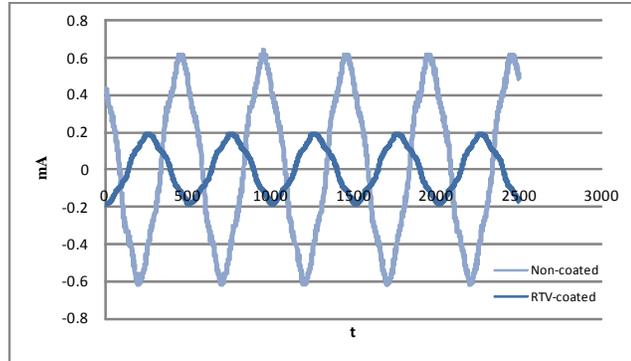


(a)

For RTV Silicone Rubber coated insulator, at applied voltage from 10 – 60 kV, the leakage current waveform distortion was symmetrical at both polarity (positive and negative half cycles) and the 5th harmonics greatly contributed to the THD. On the contrary, the 3rd harmonic component was not significant for polluted insulator with kaolin-salt pollution at 3.6 mS. The greater amounts of kaolin-salt pollution applied may increase the surface conductivity. Therefore at kaolin salt pollution at 1.3 mS and 2 mS the insulator surface were not very conductive caused the THD value larger than for kaolin salt pollution at 3.6 mS. Those are because at small amounts of kaolin-salt polluted, the 3rd harmonic more significant.

On the contrary, for non-coated insulator, at applied voltage from 40 – 60 kV, the leakage current waveform distortion was asymmetrical. Spark was observed in positive half cycles. The 5th harmonics greatly contributed to the THD. Meanwhile the 3rd harmonic component is still insignificant.

It is reported that the appearance of arcing of 3rd harmonic is always insignificant until an arc present on the surface of insulator [7]. Since the arcing was not observed in the experiment, and the 3rd harmonic component is insignificant, we can fully agree with the statement.

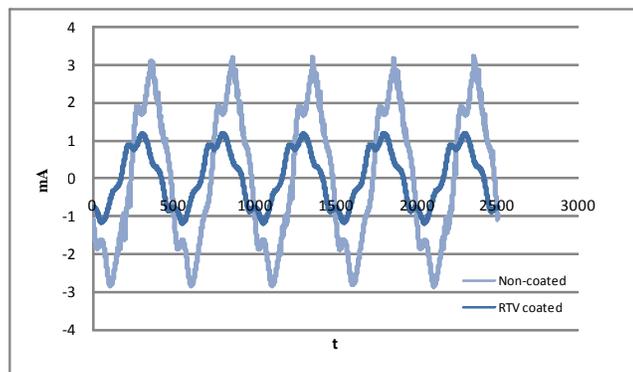


(b)


Figure 6. Typical LC waveforms for insulator polluted with kaolin-salt pollution under clean fog at applied voltage (a) 10 kV and (b) 60 kV

From Figure 7, it is clearly seen that the 3rd harmonic is small compared to 5th harmonic. The 3rd harmonic component was not larger along with the increase of voltage applied. This fact can be explained as follows. As applied voltage, usually ionization takes place on the insulator surface. Electric discharges take place if initial charge or electron is available and the instantaneous applied voltage exceeding a certain threshold value. However, this phenomenon did not occur on RTV silicone rubber surface because there electric discharges did not take place and maybe the instantaneous applied voltage did not exceed the threshold value because it is very high.

These results are typical for polluted insulator with kaolin-salt pollution under clean fog.

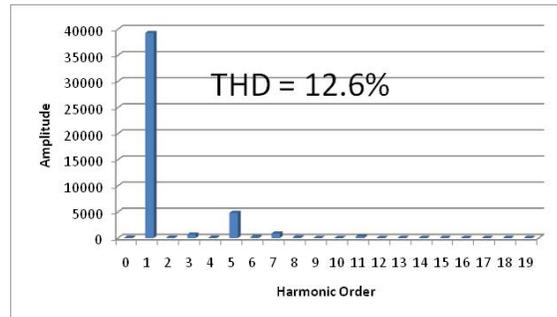


(a)

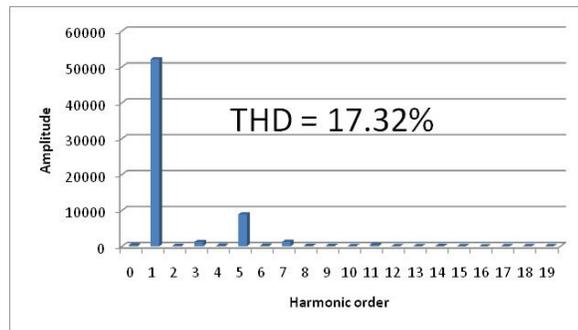


(b)

Figure 7. Typical harmonic components for insulators polluted with kaolin-salt pollution under clean fog at applied voltage (a) 40 kV and (b) 60 kV

2) *Leakage current for kaolin polluted under salt fog condition (test 5-7):* Figure 8 compared typical leakage current waveforms for RTV Silicone Rubber coated insulator and non-coated ceramic insulator for kaolin pollution under salt fog with conductivity of 2 mS, 3 mS and 3.6 mS at applied voltage (a) 10 kV, (b) 35 kV and (c) 60 kV. For RTV Silicone Rubber coated insulator, at applied voltage from 10 – 60 kV, the leakage current waveform distortion was symmetrical at both polarity (positive and negative half cycles) and the 5th harmonics greatly contributed to the THD. This is similar to those observed for insulator polluted with kaolin-salt pollution under clean fog. On the contrary, for non-coated insulator, at applied voltage from 40 – 60 kV, the leakage current waveform distortion was asymmetrical. Spark was observed in positive half cycles. The 5th harmonics greatly contributed to the THD. Meanwhile the 3rd harmonic component is still insignificant.

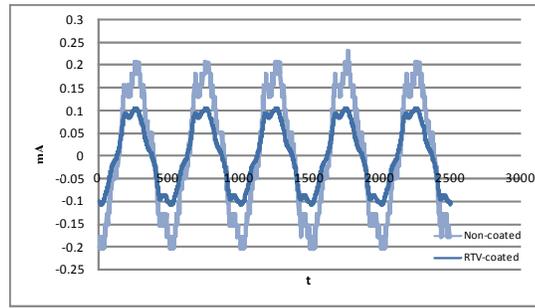


(a)

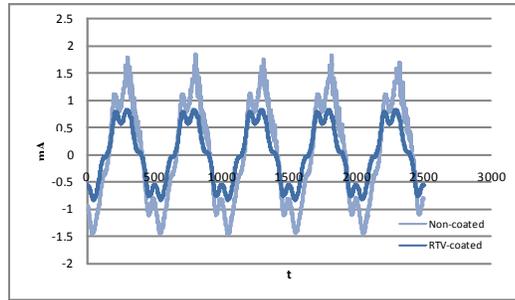


(b)

Figure 8. Typical LC waveforms for insulator polluted with kaolin pollution under salt fog at applied voltage (a) 10 kV and (b) 60 kV

From Figure 9, it is clearly seen that the 3rd harmonic is very small compared to 5th harmonic. Figure 9 also shows that for the non-coated ceramic insulator at applied voltage 60kV, the 3rd harmonic is observed, though it is still small compared to 5th harmonic. The main difference between non-coated and RTV coated insulator are the fact that the 3th harmonic more significant than the 7<sup>th</sup> harmonic. These results are typical for polluted insulator with kaolin pollution under salt fog.

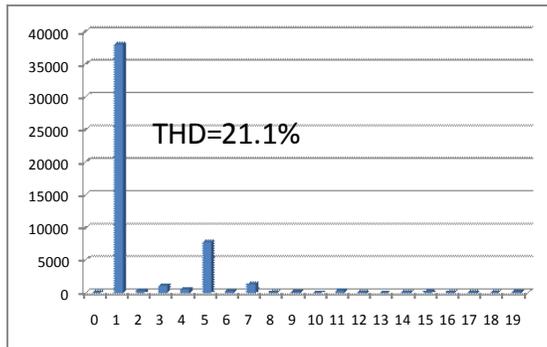

(a)

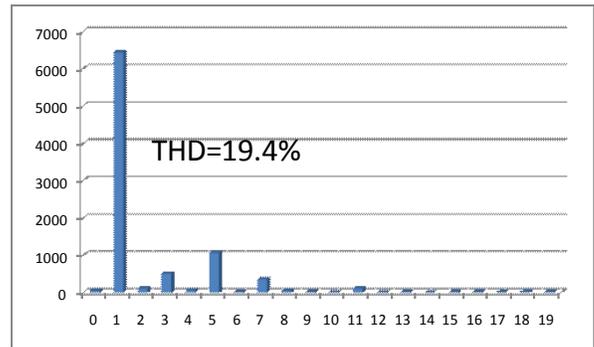

(b)

Figure 9. Typical harmonic components for (a) RTV coated insulators and (b) non-coated insulators polluted with kaolin pollution under salt fog at applied voltage 60 kV

#### D. Hydrophobicity

Hydrophobicity of a surface indicates the ability of the surface in repelling water.





Hydrophobicity is indicated by its contact angle. Hydrophobic surface has contact angle more than  $90^\circ$  while hydrophilic less than  $90^\circ$ .

Table 5 shows the contact angle measurement for both RTV coated and non-coated ceramic insulator. The contact angle of the water droplets was measured at 3 minutes after the water droplets were put on the samples. The results shows that for various artificial polluted conditions the contact angle of RTV silicone rubber coated insulator are still more than  $90^\circ$ . Meanwhile the contact angle for clean non-coated insulator is range from  $55-65^\circ$  and under polluted condition is range from  $3-9^\circ$ . These results indicated that RTV silicone rubber coated improves hydrophobicity and also able to maintain it under various polluted conditions.

These phenomena happened because of two reasons [10, 11]. On clean surface, its low surface energy does not allow wetting of the surface, and on polluted surfaces, low molecular weight silicone fluid that diffuses from the bulk of the coating surrounds contaminants with a monolayer of fluid that imparts a non-wetting property, or hydrophobicity, to the contaminant layer.


Therefore these phenomena (RTV silicone rubber coated insulator can maintain its hydrophobicity) can explain why there were not any flashover observed and the leakage current magnitude flow on insulator surface were suppressed during experiment under various artificial pollutions and there are no dry band formations.

Table 5. Typical Photographs of Water Droplets on Insulator Samples


Surface Condition	RTV Silicone Rubber Coated		Non-Coated	
	Water Droplet Profile	Contact angle (deg.)	Water Droplet Profile	Contact angle (deg.)
Clean		100 - 110		55 - 65
Kaolin polluted		95 - 100		5 - 9
Kaolin-salt 1.3mS/cm		105 - 110		3 - 8
Kaolin-salt 2mS/cm		105 - 115		5 - 8
Kaolin-salt 3.6mS/cm		100 - 105		4 - 8

### E. Surface Smoothness

Surface smoothness of RTV silicone rubber coated insulator surface is indicated by Scanning Electron Microscopy (SEM) of the insulator surface. Figure 10 (a) shows SEM of non-coated clean ceramic insulator surface and (b) shows SEM of clean RTV silicone rubber coated insulator.

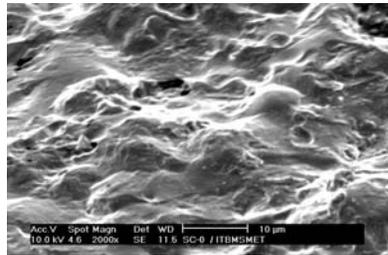

(a)

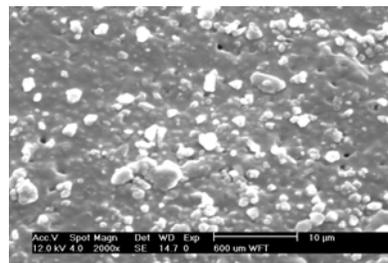

(b)

Figure 10. (a) SEM of non-coated clean ceramic insulator surface and (b) SEM of clean RTV silicone rubber coated insulator

From Figure 10, it is clearly seen that RTV silicone rubber coating increased the smoothness of insulator surface. Similar results had been found for silicone grease coated insulator. Both silicone based coated insulator has smoother surface and better hydrophobicity than the non-coated.

These results indicated RTV silicone rubber coatings improve surface smoothness. These results also indicated that smooth insulator surface tend to have good hydrophobicity. It is directly caused the leakage current flowed on insulator surface decreased. Insulator with good hydrophobicity could increase the flashover voltages, so there was not any flashover observed during experiments for applied voltage 60 kV. If insulator surface has smoother surface then it can be concluded that it has good hydrophobicity and higher surface resistance than the non-coated insulator.

### F. Flashover Voltage

Under extreme polluted condition kaolin-salt 20mS/cm, under clean fog, non coated insulators, spark observed at 35 kV and flashover at applied voltage of about 50 kV. However, silicone-coated insulator did not show any flashover and spark until 60 kV for an hour test. Figure 11 shows typical insulator flashover. These experiments indicate that RTV silicone rubber coating increases flashover voltage of ceramic insulator under polluted condition. RTV Silicone Rubber coating successfully overcome some ceramic insulator weaknesses especially under certain environmental factors such as humidity, rainy season and pollution which may reduce their surface resistance. These results also indicate that the coating reduces leakage current and furthermore reduce dry band arcing that might occur on the ceramic insulator surface so there are no flashover observed of RTV Silicone Rubber coating insulator.



Figure 11. Flashover on the uncoated insulator

#### 4. Conclusions

The performance of ceramic insulator coated with RTV silicone rubber under artificially - simulated pollution has been investigated. From these experimental results following conclusions can be drawn.

RTV silicone rubber coating improves the surface smoothness and hydrophobicity. The results also shows that for various artificial polluted conditions the contact angle of RTV silicone rubber coated insulator are still more than  $90^\circ$ . These indicated that RTV silicone rubber coated insulator can maintain its hydrophobicity under various polluted condition.

RTV silicone rubber coating suppressed the magnitude of leakage current, the harmonic content of leakage current and increased the flashover voltage under various artificially - simulated pollution. The low LC corresponds with high surface resistance which indicates high quality of insulator.

The gradient of cross product between LC magnitude and THD value is a new indicator for showing insulator condition. The gradient of cross product for non-coated insulator generally higher than the RTV coated insulator. This indicator agrees with the experimental results. The RTV coated has lower gradient of cross product value which clearly indicates that application of RTV coated improves the performance of ceramic insulator.

These results indicate that RTV silicone rubber coating improves the performance of ceramic outdoor insulator to overcome pollution effect. RTV silicone rubber coated insulator is suitable to be placed at highly polluted areas such as seashores, industrial parks and other highly polluted areas.

#### References

- [1] Gorur, R S, E A Cherney, and J T Burnham. Outdoor Insulators. Arizona: Ravi Gorur Inc, 1999.
- [2] Siderakis, K, D Agoris, P Eleftheria, and E Thalassinakis. "Investigation of Leakage Current on High Voltage Insulators-Field Measurements." *WSEAS Transaction on Circuits and System*, 2004: 1188-1191.
- [3] Suda, T. "Frequency Characteristics of Leakage Current Waveforms of a String of Suspension Insulators." *IEEE Transactions on Power Delivery*, 2005: 481-487.
- [4] El Hag et. Al, "Fundamental and low Freq. components of LC as a diagnostic Tool to Study Aging of RTV and HTV SIR in Salt-Fog," *IEEE DEIS Trans. Vol. 10, No. 1, 2003*, pp. 128- 136.
- [5] Suwarno, Wayan W, "Improving the Performances of Outdoor ceramic Insulators under Severe Conditions by Using Silicone Compound Coatings", *WSEAS Transaction on Power System, Issue 6, Volume 1, June 2006 pp. 1001-1008*

- [6] Suwarno, "Leakage Current Waveforms of Outdoor Polymeruc Insulators and Possibility of Application for Diagnosis of Insulator Conditions". *The Korean Institute of Electrical Engineers Journal pf Electrical Engineering and Technologies, Vol.1, No.1*, pp. 114-119, 2006.
- [7] Suwarno, and Parhusip, Juniko Parlinggoman. "Investigation on Leakage Current Waveforms and Flashover Characteristics of Ceramics for Outdoor Insulators under Clean and Salt Fogs". *WSEAS Trans. Power System, Vol. 3, Issue 6, 2008*, pp. 456-465.
- [8] Cherney, E A, and R S Gorur. "RTV Silicone Rubber Coatings for Outdoor Insulator." *IEEE Transactions on Dielectrics and Electrical Insulation*, 2006.
- [9] Kim, Jeong Ho, et al. "Leakage Current Monitoring and Outdoor Degradation of SIR." *IEEE transaction on Dielectrics and Electrical Insulation*, 2001: 1108-1115.
- [10] Devendranath, D, Channakeshava, and A D Rajkumar. "Leakage Current and Charge in RTV Coated Insulators under Pollution Conditions." *IEEE Transactions on Dielectrics and Electrical Inslations*, 2002.
- [11] Kim, Seog-Hyeon, Edward A Cherney, and Ruben Hackam. "Hydrophobic Behaviour of Insulators Coated With RTV Silicone Rubber." *IEEE Transactions on Electrical Insulation*, 1992.
- [12] Suwarno, & Pratomosiwi, F. "Application of RTV Silicone Rubber Coating for Improving Performance of Ceramic Outdoor Insulator under Polluted Condition." *International Conference on Electrical Engineering and Informatics 2009*,



**Fari Pratomosiwi** was born in Jayapura, Indonesia, in 1985. He received B. Eng. Degree in Electrical Engineering from Bandung Institute of Technology in 2007. He completed his Masters in Electrical Engineering also from Bandung Institute of Technology, in 2009. Currently he is an academic assistant at Bandung Institute of Technology. His research interests include high voltage insulation, electrical power system distribution, and computer simulation of electrical power engineering.



**Dr. Suwarno** was born in Indonesia in 1965. He received BSc and MSc from The Department of Electrical Engineering, Bandung Institute of Technology, Bandung, Indonesia in 1988 and 1991 respectively. He received Dr. Eng. from Nagoya University, Japan in 1996 in the field of High Voltage Electrical Insulation. Dr. Suwarno is an associate professor of The School and Vice Dean, Bandung Institute of Technology. His research interests are High Voltage Insulating Materials and Technology, Electromagnetic Compatibility and High Voltage Industrial Application. Dr. Suwarno is recipient of The Best Paper Award from IEEE Queensland (ICPADM 1994), Excellent Paper Awards from IEE Japan 1994 and 1995 and Best Paper Presentation from ACED (Seoul 2003). Dr. Suwarno is a member of International Advisory Committee of ICPADM, ISEIM, CMD and a member of International Technical Committee of ISH 2007 and The General Chairman of ICPADM 2006 and ICEEI 2007. Dr. Suwarno is a member IEEE.